FCC/ISED EMC Test Report

Report No.	:	BTL-FCCE-1-2605T132
Equipment	:	APM-EMA : Multi-Circuit Power Meter (DIN rail) APM-MAA: Current Input Module (Optional)
Model Name	:	APM-EMA, APM-MAA
Brand Name	:	ADTEK
Applicant	:	ADTEK ELECTRONICS CO., LTD.
Address	:	5F., No. 14, Lane 609, Sec. 5, Chongxin Rd., Sanchong Dist., New Taipei City 24159, Taiwan
FCC Rule Part(s)	:	FCC CFR Title 47, Part 15, Subpart B Class A
ISED Standard(s)	:	ICES-003, Issue 7, October 15, 2020 Class A
Measurement Procedure(s)	:	ANSI C63.4-2014+C63.4a-2017
Date of Receipt	:	2026/5/26
Date of Test	:	2026/7/7~2026/7/9
Issued Date	:	2026/8/4

The above equipment has been tested and found in compliance with the requirement of the above standards by BTL Inc.

Prepared by : Ray Chen, Engineer

Approved by : Pike Lee, Director

BTL Inc.
No.18, Ln. 171, Sec. 2, Jiuzong Rd., Neihu Dist., Taipei City 114, Taiwan
Tel: +886-2-2657-3299 Fax: +886-2-2657-3331 Web: www.btl.com.tw Service mail: btl_qa@btl.com.tw

Declaration

BTL represents to the client that testing is done in accordance with standard procedures as applicable and that test instruments used has been calibrated with standards traceable to international standard(s) and/or national standard(s).

BTL's reports apply only to the specific samples tested under conditions. It is manufacture's responsibility to ensure that additional production units of this model are manufactured with the identical electrical and mechanical components. BTL assumes no responsibility for the data provided by the Customer, any statements, inferences or generalizations drawn by the customer or others from the reports issued by BTL.

This report is the confidential property of the client. As a mutual protection to the clients, the public and ourselves, the test report shall not be reproduced, except in full, without our written approval.

BTL's laboratory quality assurance procedures are in compliance with the **ISO/IEC 17025** requirements, and accredited by the conformity assessment authorities listed in this test report.

BTL is not responsible for the sampling stage, so the results only apply to the sample as received.

The information, data and test plan are provided by manufacturer which may affect the validity of results, so it is manufacturer's responsibility to ensure that the apparatus meets the essential requirements of applied standards and in all the possible configurations as representative of its intended use.

Limitation

For the use of the authority's logo is limited unless the Test Standard(s)/Scope(s)/Item(s) mentioned in this test report is (are) included in the conformity assessment authorities acceptance respective.

Please note that the measurement uncertainty is provided for informational purpose only and are not use in determining the Pass/Fail results.

REVISION HISTORY

Report No.	Version	Description	Issued Date	Note
BTL-FCCE-1-2605T132	R00	Original Report.	2026/8/4	Valid

CONTENTS

CONTENTS		4
1	SUMMARY OF TEST RESULTS	5
1.1	TEST FACILITY	6
1.2	MEASUREMENT UNCERTAINTY	6
1.3	TEST ENVIRONMENT CONDITIONS	6
2	GENERAL INFORMATION	7
2.1	EUT INFORMATION	7
2.2	TEST MODES	8
2.3	EUT OPERATING CONDITION	8
2.4	TESTED CONFIGURATION DIAGRAM	9
2.5	SUPPORT UNITS	10
3	EMC EMISSION TEST	11
3.1	CONDUCTED EMISSIONS TEST	11
3.1.1	LIMITS	11
3.1.2	MEASUREMENT INSTRUMENTS LIST	11
3.1.3	TEST PROCEDURE	12
3.1.4	DEVIATION FROM TEST STANDARD	12
3.1.5	TEST SETUP	12
3.1.6	TEST RESULT	13
3.2	RADIATED EMISSIONS BELOW 1 GHZ TEST	15
3.2.1	LIMITS - FCC	15
3.2.2	LIMITS - ICES	16
3.2.3	MEASUREMENT INSTRUMENTS LIST	17
3.2.4	TEST PROCEDURE	18
3.2.5	DEVIATION FROM TEST STANDARD	18
3.2.6	TEST SETUP	18
3.2.7	TEST RESULT - FCC	19
3.2.8	TEST RESULT - ICES	21
4	TEST PHOTOS	23
5	EUT PHOTOS	25

1 SUMMARY OF TEST RESULTS

Emission			
Standard	Test Item	Limit	Judgment
FCC CFR Title 47, Part 15, Subpart B ICES-003, Issue 7, October 15, 2020	AC power line conducted emissions	Class A	PASS
	Radiated emissions below 1 GHz	Class A	PASS
	Radiated emissions above 1 GHz	----------	N/A

Statement of Conformity
The statement of conformity is based on the binary decision rule according to IEC Guide 115 and ILAC G8 "simple acceptance" principle. Without considering measurement uncertainty, its specific risk is less than 50% PFA. (PFA: Probability of False Accept)

NOTE:
(1) ”N/A” denotes test is not applicable in this Test Report.
(2) Due to the limits of applied standards are different, but the test setup and test procedure are identical, the test results of this item are multiple recorded with corresponding limits.
(3) The report format version is TP.1.1.3.

1.1 TEST FACILITY

TAF Accreditation Number is 0659;
The satellite facilities under the test firm used to collect the test data in this report are:

FCC Designation Number is TW1154.
1F,2F, No.91, Ln. 298, Wengong 1st Rd., Guishan Dist., Taoyuan City, Taiwan
☒ C01 ☐ CB02 ☒ CB03

1.2 MEASUREMENT UNCERTAINTY

The reported uncertainty of measurement **y ± U**, where expanded uncertainty **U** is based on a standard uncertainty multiplied by a coverage factor of **k = 2**, providing a level of confidence of approximately **95 %**. The measurement instrumentation uncertainty is in accordance with CISPR 16-4-2. The BTL measurement uncertainty is less than the CISPR 16-4-2 U_{cispr} requirement.

A. AC power line conducted emissions test:

Test Site	Method	Measurement Frequency Range	U (dB)	U_{cispr} (dB)
C01	CISPR	9 kHz ~ 150 kHz	3.5	3.8
		150 kHz ~ 30 MHz	3.0	3.4

B. Radiated emissions test:

Test Site	Method	Measurement Frequency Range	U (dB)	U_{cispr} (dB)
CB03	CISPR	0.009 kHz ~ 30 MHz	3.1	3.3
		30 MHz ~ 1000 MHz	5.8	6.3
		1 GHz ~ 6 GHz	4.1	5.2
		6 GHz ~ 18 GHz	4.5	5.5
		18 GHz ~ 40 GHz	3.5	-

NOTE:
Unless specifically mentioned, the uncertainty of measurement has not been taken into account to declare the compliance or non-compliance to the specification.

1.3 TEST ENVIRONMENT CONDITIONS

Test Item	Environment Condition	Tested by
Conducted emissions	27°C, 40%	Rui Huang
Radiated emissions below 1 GHz	23°C, 61%	Rui Huang

2 GENERAL INFORMATION

2.1 EUT INFORMATION

Equipment	APM-EMA : Multi-Circuit Power Meter (DIN rail) APM-MAA: Current Input Module (Optional)
Model Name	APM-EMA, APM-MAA
Brand Name	ADTEK
Model Difference	APM-EMA LED Board IPV Main Board (600Vac 3P Voltage Input & RS485) MCU: STM32H562VGT6 IPV Power Board (DC 12~48V (±10%)) IPA LED Board IPA Main Board (333m Vac (from CT) Input*6 (RJ11)) MCU: STM32H562VGT6 IPA Power Board (DC 12~48V (±10%)) APM-MAA IPA LED Board IPA Main Board (333m Vac (from CT) Input*6 (RJ11)) MCU: STM32H562VGT6 IPA Power Board (DC 12~48V (±10%))
Power Source	AC Mains
Power Rating	DC 12~48V (±10%); (APM-EMA<2.5W, APM-MAA<1.5W) INPUT:600Vac,1P/3P(Prog)*1ch,333mVac,45~65Hz*3Φ-6ch
Adapter Rating	MEAN WELL / MDR-20-24 INPUT: 100-240VAC 0.55A 50/60Hz OUTPUT: 24VDC 1.0A
Products Covered	N/A
Test Model	APM-EMA, APM-MAA
Sample Status	Engineering Sample
Highest Internal Frequency	84 MHz
EUT Modification(s)	N/A

NOTE:
(1) The above EUT information is declared by manufacturer and for more detailed features description, please refer to the manufacturer's specifications or user's manual.

2.2 TEST MODES

The test system was pre-tested considering all possible combinations of EUT operation modes according to test plan.

Pretest Mode	Description
Mode 1	Normal Operation APM-EMA
Mode 2	Normal Operation APM-MAA

The following modes were found to be the worst cases and selected for the final test.

Final Test Mode	Radiated emissions below 1 GHz test
	Description
Mode 1	Normal Operation APM-EMA

Final Test Mode	Conducted emissions from the AC mains power ports test
	Description
Mode 1	Normal Operation APM-EMA

2.3 EUT OPERATING CONDITION

The EUT exercise program (APM-SW-V15_20260304) used during radiated and/or conducted emissions measurement was designed to exercise the various system components in a manner similar to a typical use.

2.4 TESTED CONFIGURATION DIAGRAM

Equipment letters and Cable numbers refer to item numbers described in the tables of clause 2.5.

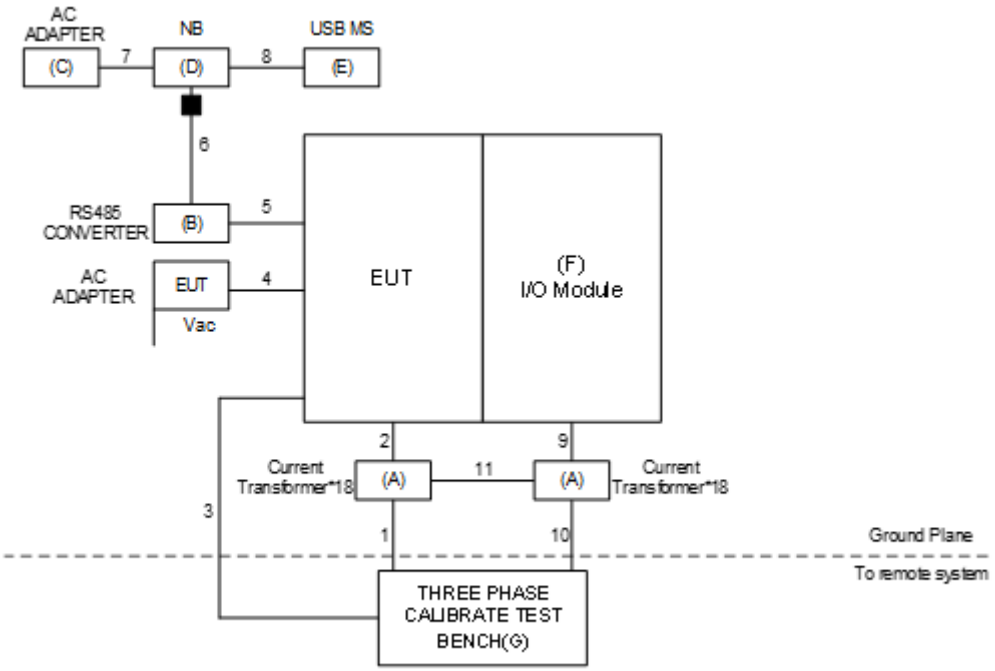

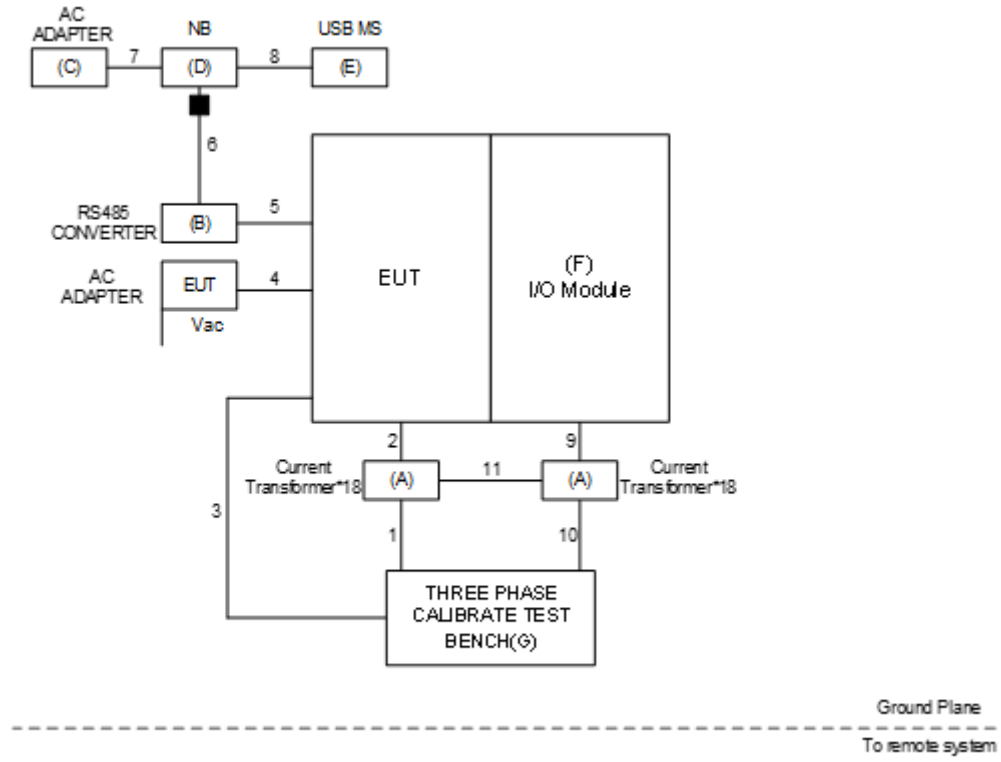

2.5 SUPPORT UNITS

Item	Equipment	Brand	Model No.	Series No.	Remarks
A	Current Transformer	ADTEK	US-CTQ-10-005	1250922957B3	Supplied by test requester
B	RS485 CONVERTER	ADTEK	PL-STU-11	N/A	Supplied by test requester
C	AC ADAPTER	LENOVO	ADLX65YLC3D	N/A	Furnished by test lab.
D	Notebook PC	Lenovo	21C2SA2100	PW06AD9E	Furnished by test lab.
E	USB Mouse	DELL	MS116p	N/A	Furnished by test lab.
F	I/O Module	ADTEK	APM-MAA	N/A	Supplied by test requester
G	THREE PHASE CALIBRATE TEST BENCH	KAIPU	KP-P3001-C	N/A	Supplied by test requester

Item	Cable Type	Shielded	Ferrite Core	Length	Remarks
1	POWER CABLE*3	NO	NO	3m	Furnished by test lab.
2	RJ12 CABLE*6	YES	NO	2m	Supplied by test requester
3	POWER CABLE*4	NO	NO	3m	Furnished by test lab.
4	POWER CABLE	NO	NO	1.2m	Furnished by test lab.
5	POWER CABLE	NO	NO	1m	Supplied by test requester
6	USB CABLE	YES	YES	1.8m	Supplied by test requester
7	TYPE C CABLE	YES	NO	1.2m	Furnished by test lab.
8	USB CABLE	YES	NO	1.7m	Furnished by test lab.
9	RJ12 CABLE*6	YES	NO	2m	Supplied by test requester
10	POWER CABLE*3	NO	NO	3m	Furnished by test lab.
11	POWER CABLE*3	NO	NO	1.6m	Furnished by test lab.

3 EMC EMISSION TEST

3.1 CONDUCTED EMISSIONS TEST

3.1.1 LIMITS

Frequency (MHz)	Class A (dBμV)		Class B (dBμV)	
	Quasi-peak	Average	Quasi-peak	Average
0.15 - 0.5	79	66	66 - 56 *	56 - 46 *
0.50 - 5.0	73	60	56	46
5.0 - 30.0	73	60	60	50

NOTE:
(1) The tighter limit applies at the band edges.
(2) The limit of " * " marked band means the limitation decreases linearly with the logarithm of the frequency in the range.
(3) The test result calculated as follows:
Measurement Value = Reading Level + Correct Factor
Correct Factor = Insertion Loss + Cable Loss + Attenuator Factor (if use)
Margin Level = Measurement Value – Limit Value
Calculation example:

Reading Level (dBμV)		Correct Factor (dB)		Measurement Value (dBμV/m)		Limit Value (dBμV/m)		Margin Level (dB)
38.22	+	3.45	=	41.67	-	60	=	-18.33

3.1.2 MEASUREMENT INSTRUMENTS LIST

Item	Kind of Equipment	Manufacturer	Type No.	Serial No.	Calibrated Date	Calibrated Until
1	Test Cable	EMCI	EMCRG142S-SM-SM-5000	230609	2025/8/8	2026/8/7
2	EMI Test Receiver	R&S	ESR3	103133	2025/9/3	2026/9/2
3	LISN	Schwarzbeck	NNLK 8129	00664	2026/3/18	2027/3/17
4	Pulse Limiter	Schwarzbeck	VTSD 9561-F	01165	2025/9/24	2026/9/23
5	Measurement Software	Farad	EZ_EMC (Ver.E-LAB-5A2.2 2021)	N/A	N/A	N/A

REMARK:
(1) “N/A” denotes no model name, no serial no. or no calibration specified.
(2) All calibration period of equipment list is one year.

3.1.3 TEST PROCEDURE

a. The EUT was placed 0.8 m above the horizontal ground plane with the EUT being connected to the power mains through a line impedance stabilization network (LISN).
All other support equipment were powered from an additional LISN(s).
The LISN provides 50 Ohm/50uH of impedance for the measuring instrument.
b. Interconnecting cables that hang closer than 40 cm to the ground plane shall be folded back and forth in the center forming a bundle to keep the cable above 40 cm.
c. Excess I/O cables that are not connected to a peripheral shall be bundled in the center.
The end of the cable will be terminated, using the correct terminating impedance.
The overall length shall not exceed 1 m.
d. The LISN is spaced at least 80 cm from the nearest part of the EUT chassis.
e. The receiver was set to quasi-peak and average detect function and specified bandwidth with maximum hold mode.
f. For the actual test configuration, please refer to the related Item - TEST PHOTOS.

3.1.4 DEVIATION FROM TEST STANDARD

No deviation.

3.1.5 TEST SETUP

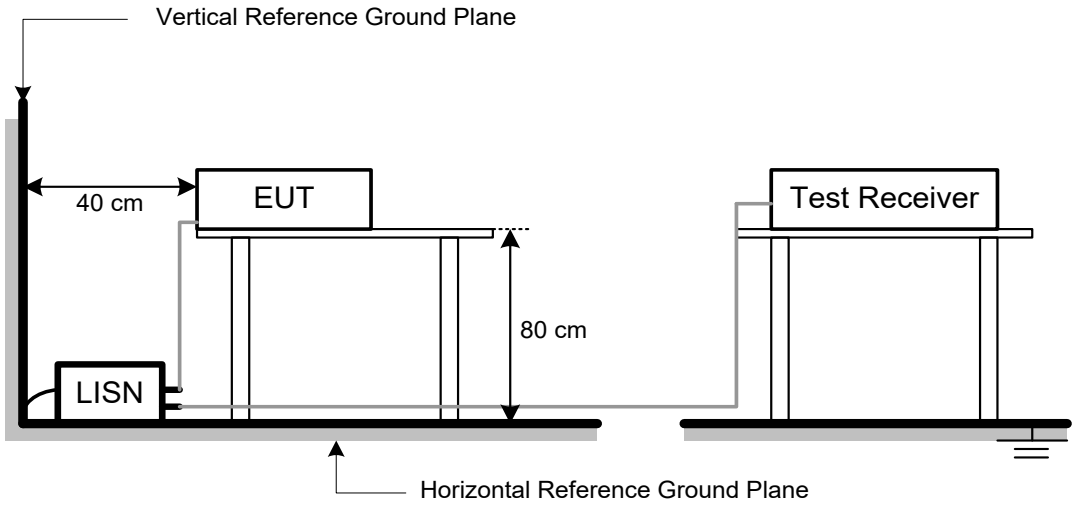

3.1.6 TEST RESULT

Test Mode	Mode 1	Tested Date	2026/7/8
Test Voltage	AC 120V/60Hz	Phase	Line

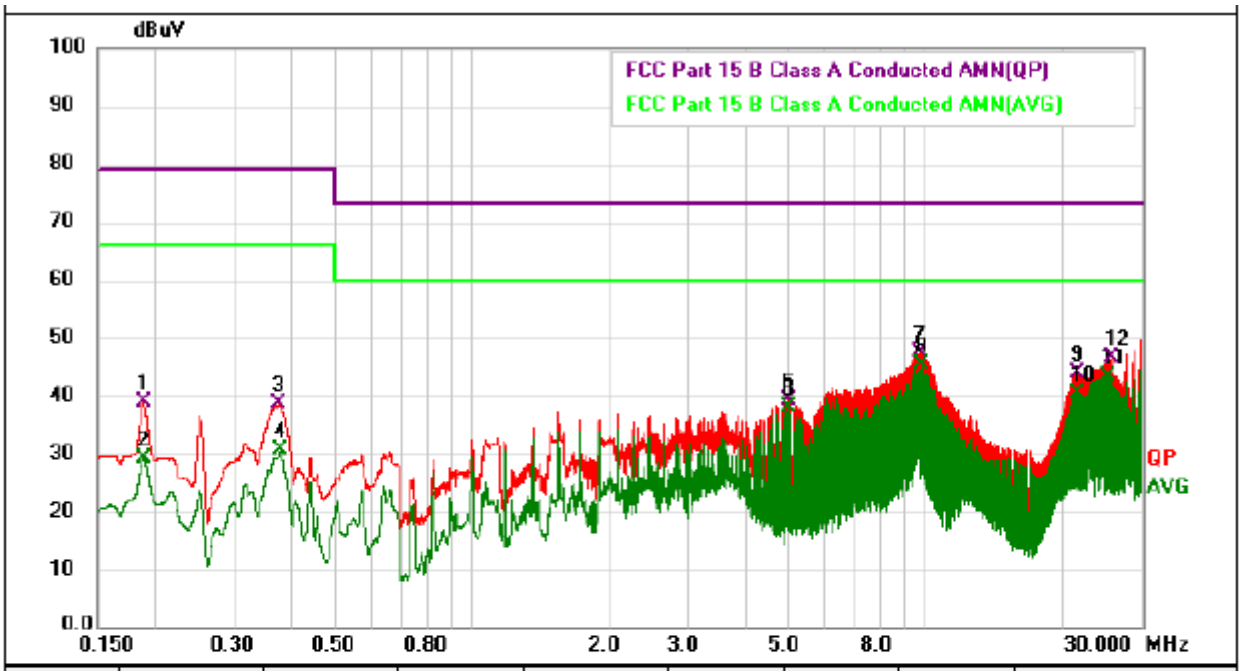

No.		Freq. (MHz)	Reading (dBuV)	Factor (dB)	Meas. Level (dBuV)	Limit (dBuV)	Margin (dB)	Detector	Comment
1		0.188250	28.76	10.10	38.86	79.00	-40.14	QP	
2		0.188250	19.15	10.10	29.25	66.00	-36.75	AVG	
3		0.375000	28.50	10.14	38.64	79.00	-40.36	QP	
4		0.377250	20.71	10.14	30.85	66.00	-35.15	AVG	
5		4.989750	28.98	10.33	39.31	73.00	-33.69	QP	
6		4.989750	27.85	10.33	38.18	60.00	-21.82	AVG	
7		9.732750	37.18	10.42	47.60	73.00	-25.40	QP	
8	*	9.793500	35.08	10.42	45.50	60.00	-14.50	AVG	
9		21.675750	33.42	10.55	43.97	73.00	-29.03	QP	
10		21.675750	29.84	10.55	40.39	60.00	-19.61	AVG	
11		25.316250	32.57	10.95	43.52	60.00	-16.48	AVG	
12		25.683000	35.64	10.99	46.63	73.00	-26.37	QP	

REMARKS:
(1) Measurement Value = Reading Level + Correct Factor.
(2) Margin Level = Measurement Value - Limit Value.

Test Mode	Mode 1	Tested Date	2026/7/8
Test Voltage	AC 120V/60Hz	Phase	Neutral

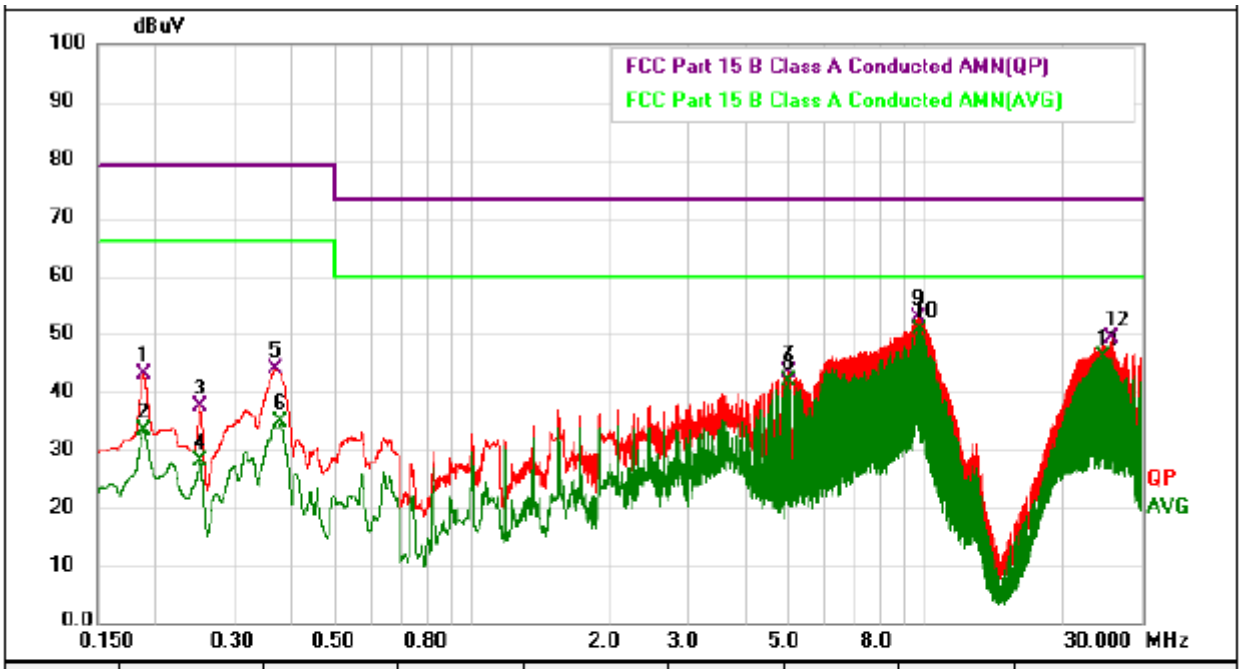

No.		Freq. (MHz)	Reading (dBuV)	Factor (dB)	Meas. Level (dBuV)	Limit (dBuV)	Margin (dB)	Detector	Comment
1		0.188250	32.97	10.11	43.08	79.00	-35.92	QP	
2		0.188250	23.35	10.11	33.46	66.00	-32.54	AVG	
3		0.251250	27.28	10.12	37.40	79.00	-41.60	QP	
4		0.251250	18.06	10.12	28.18	66.00	-37.82	AVG	
5		0.368250	33.69	10.15	43.84	79.00	-35.16	QP	
6		0.379500	24.56	10.16	34.72	66.00	-31.28	AVG	
7		4.989750	32.94	10.32	43.26	73.00	-29.74	QP	
8		4.989750	31.52	10.32	41.84	60.00	-18.16	AVG	
9		9.669750	42.43	10.43	52.86	73.00	-20.14	QP	
10	*	9.732750	40.25	10.43	50.68	60.00	-9.32	AVG	
11		24.778500	35.22	10.91	46.13	60.00	-13.87	AVG	
12		25.689750	38.33	11.00	49.33	73.00	-23.67	QP	

REMARKS:
(1) Measurement Value = Reading Level + Correct Factor.
(2) Margin Level = Measurement Value - Limit Value.

3.2 RADIATED EMISSIONS BELOW 1 GHZ TEST

3.2.1 LIMITS - FCC

FCC CFR Title 47, Part 15, Subpart B:

Frequency (MHz)	Class A (at 10 m)		Class A (at 3 m)*	Class B (at 3 m)	
	(μV/m) Field strength	(dBμV/m) Field strength	(dBμV/m) Field strength	(μV/m) Field strength	(dBμV/m) Field strength
30 - 88	90	39	49.46	100	40
88 - 216	150	43.5	53.96	150	43.5
216 - 960	210	46.4	56.86	200	46
Above 960	300	49.5	59.96	500	54
* FCC CFR Title 47, Part 15, Subpart A, section 15.31(f)(1), the distance could be extrapolated by using 20 dB/decade factor.					

Alternative Limits:

Frequency (MHz)	Class A (at 10 m)	Class B (at 10 m)
	dBμV/m	dBμV/m
30 - 230	40	30
230 - 1000	47	37
FCC CFR Title 47, Part 15, Subpart B, section 15.109(g) provides, as an alternative, compliance to the CISPR 22 (Third Edition) radiated emission limits in the 30 MHz to 1000 MHz range.		

Frequency range of radiated measurements (For unintentional radiators)

Highest frequency generated or Upper frequency of measurement used in the device or on which the device operates or tunes (MHz)	Range (MHz)
Below 1.705	30
1.705 - 108	1000
108 - 500	2000
500 - 1000	5000
Above 1000	5th harmonic of the highest frequency or 40 GHz, whichever is lower

NOTE:
(1) The tighter limit applies at the band edges.
(2) Emission level (dBμV/m) = 20log Emission level (μV/m).
3 m Emission level = 10 m Emission level + 20log(10 m/3 m).
(3) The test result calculated as following:
Measurement Value = Reading Level + Correct Factor
Correct Factor = Antenna Factor + Cable Loss - Amplifier Gain (if use)
Margin Level = Measurement Value - Limit Value
Calculation example:

Reading Level (dBμV)		Correct Factor (dB/m)		Measurement Value (dBμV/m)		Limit Value (dBμV/m)		Margin Level (dB)
19.11	+	2.11	=	21.22	-	40	=	-18.78

3.2.2 LIMITS - ICES

Frequency range (MHz)	Class A		Class B	
	(dBµV/m) (at 3 m)	(dBµV/m) (at 10 m)	(dBµV/m) (at 3 m)	(dBµV/m) (at 10 m)
	Quasi-peak	Quasi-peak	Quasi-peak	Quasi-peak
30 – 88	50.0	40.0	40.0	30.0
88 – 216	54.0	43.5	43.5	33.1
216 – 230	56.9	46.4	46.0	35.6
230 – 960	57.0	47.0	47.0	37.0
960 – 1000	60.0	49.5	54.0	43.5

Required highest measurement frequency for radiated emissions

Highest internal frequency (F_X)	Highest measurement frequency (F_M)
$F_X \leq 108$ MHz	1 GHz
108 MHz < $F_X \leq 500$ MHz	2 GHz
500 MHz < $F_X \leq 1$ GHz	5 GHz
$F_X > 1$ GHz	5 x F_X up to a maximum of 40 GHz

NOTE:
(1) The more stringent limit applies at transition frequencies.
(2) F_X is the highest fundamental frequency generated and/or used in the ITE or digital apparatus under test.
(3) Emission level (dBµV/m) = 20log Emission level (µV/m).
3 m Emission level = 10 m Emission level + 20log(10 m/3 m).
(4) The test result calculated as following:
Measurement Value = Reading Level + Correct Factor
Correct Factor = Antenna Factor + Cable Loss - Amplifier Gain (if use)
Margin Level = Measurement Value - Limit Value
Calculation example:

Reading Level (dBµV)		Correct Factor (dB/m)		Measurement Value (dBµV/m)		Limit Value (dBµV/m)		Margin Level (dB)
19.11	+	2.11	=	21.22	-	40	=	-18.78

3.2.3 MEASUREMENT INSTRUMENTS LIST

Item	Kind of Equipment	Manufacturer	Type No.	Serial No.	Calibrated Date	Calibrated Until
1	Log-Bicon Antenna	Schwarzbeck	VULB 9168	01578	2025/7/31	2026/7/30
2	Attenuator	INMET	EMCI-N-6-05	AT-N0576	2025/7/31	2026/7/30
3	Pre-Amplifier	EMCI	EMC001330	980908	2025/7/22	2026/7/21
4	Test Cable	EMCI	EMC104-SM-SM-6000	230539	2025/7/22	2026/7/21
5	Test Cable	EMCI	EMC104-SM-SM-2500	230542	2025/7/22	2026/7/21
6	Test Cable	EMCI	EMC104-SM-SN-1000	230543	2025/7/22	2026/7/21
7	EXA Signal Analyzer	Keysight	N9010A	MY52220990	2025/10/1	2026/9/30
8	Measurement Software	Farad	EZ_EMC (Ver. NB-03A1-01)	N/A	N/A	N/A

REMARK:
(1) “N/A” denotes no model name, no serial no. or no calibration specified.
(2) All calibration period of equipment list is one year.

3.2.4 TEST PROCEDURE

a. The separation distance of 3 m was used for measurements below 1 GHz.
The EUT was placed on the top of a rotating table 0.8 m above the ground in a 3 m semi-anechoic chamber.
b. The table was rotated 360 degrees to determine the position of the highest radiation.
c. The height of the receive antenna was varied between 1 m and 4 m. Both horizontal and vertical polarizations of the antenna were checked.
d. For each suspected emission, the EUT was arranged at its worst case and then the antenna was scanned in height to find the maximum.
e. The receiver was set to quasi-peak detect function and specified bandwidth with maximum hold mode.
f. For the actual test configuration, please refer to the related Item - TEST PHOTOS.

3.2.5 DEVIATION FROM TEST STANDARD

No deviation.

3.2.6 TEST SETUP

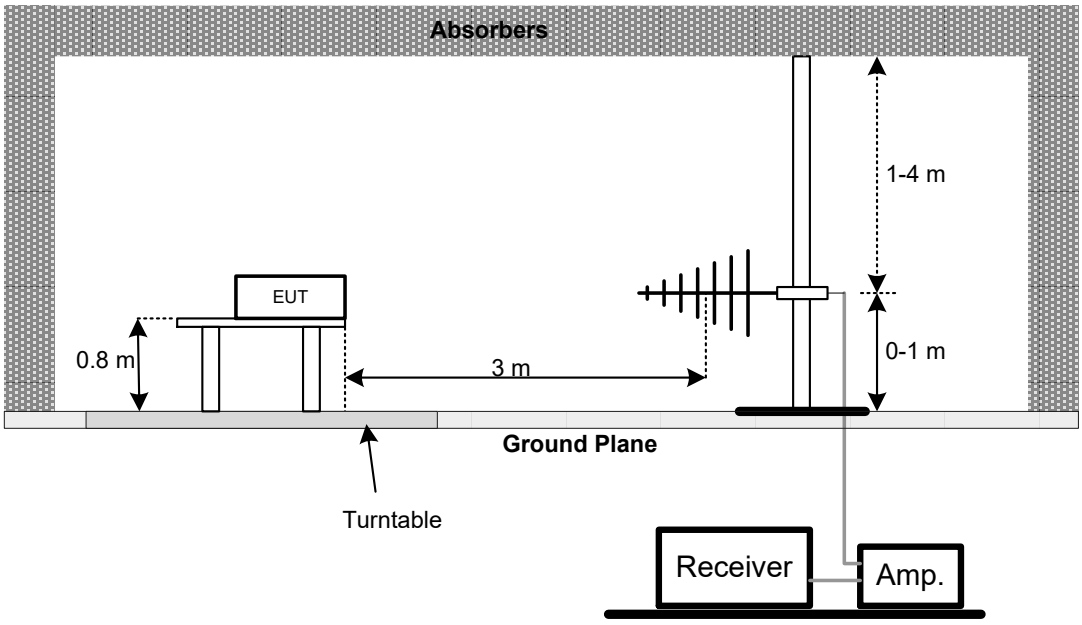

3.2.7 TEST RESULT - FCC

Test Mode	Mode 1	Tested Date	2026/7/9
Test Voltage	AC 120V/60Hz	Polarization	Vertical

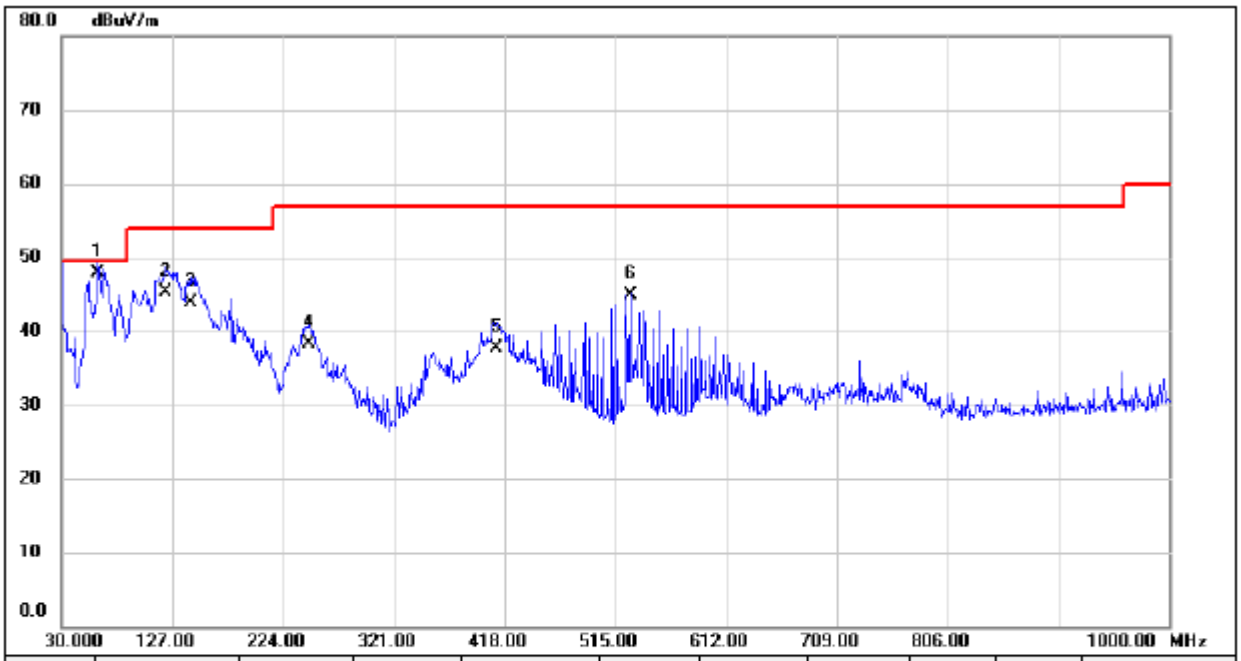

No.		Freq. (MHz)	Reading (dBuV)	Factor (dB/m)	Meas. Level (dBuV/m)	Limit (dBuV/m)	Margin (dB)	Detector	Height (cm)	Degree (deg.)	Comment
1	*	62.0100	61.01	-13.02	47.99	49.46	-1.47	QP	100	114	
2		121.1800	59.95	-14.59	45.36	53.96	-8.60	QP	100	210	
3		142.5200	56.56	-12.58	43.98	53.96	-9.98	QP	100	94	
4		246.3100	51.57	-13.28	38.29	56.86	-18.57	QP	100	78	
5		410.2400	45.98	-8.28	37.70	56.86	-19.16	QP	100	178	
6		528.5800	50.96	-6.07	44.89	56.86	-11.97	QP	100	158	

REMARKS:
(1) Measurement Value = Reading Level + Correct Factor.
(2) Margin Level = Measurement Value - Limit Value.

Test Mode	Mode 1	Tested Date	2026/7/9
Test Voltage	AC 120V/60Hz	Polarization	Horizontal

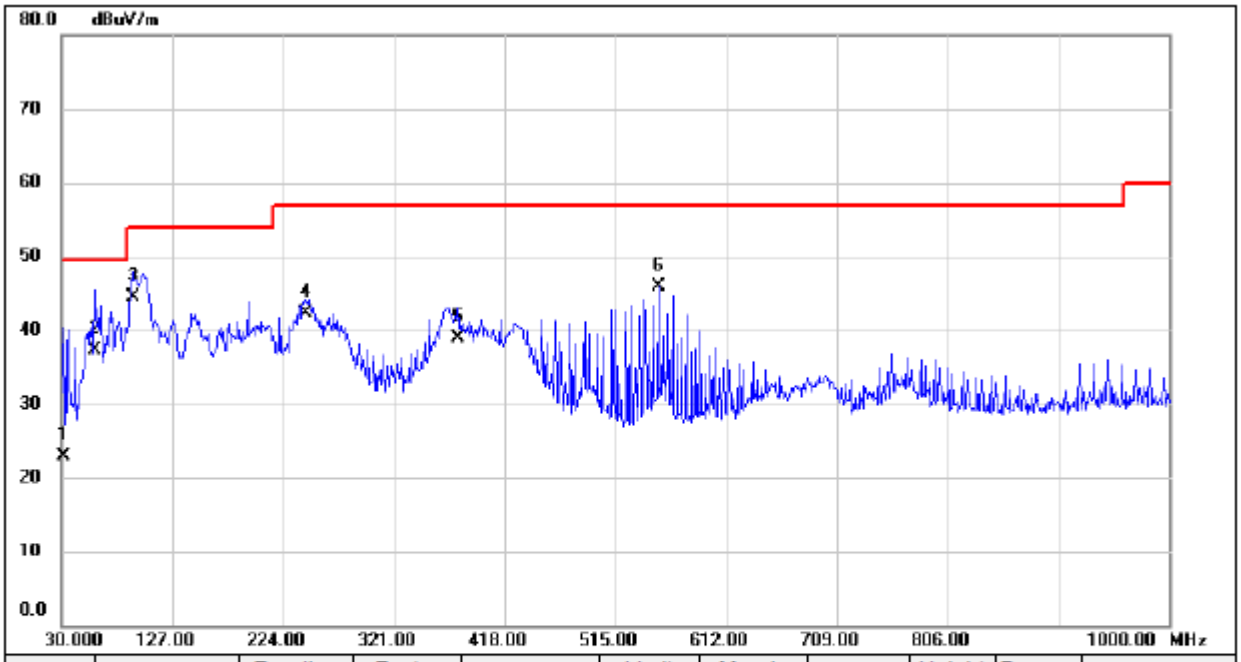

No.		Freq. (MHz)	Reading (dBuV)	Factor (dB/m)	Meas. Level (dBuV/m)	Limit (dBuV/m)	Margin (dB)	Detector	Height (cm)	Degree (deg.)	Comment
1		31.9400	36.36	-13.45	22.91	49.46	-26.55	QP	100	287	
2		59.1000	49.87	-12.56	37.31	49.46	-12.15	QP	100	291	
3	*	92.0800	62.55	-18.05	44.50	53.96	-9.46	QP	200	77	
4		244.3700	55.67	-13.43	42.24	56.86	-14.62	QP	100	307	
5		377.2600	48.17	-9.22	38.95	56.86	-17.91	QP	100	227	
6		552.8300	51.45	-5.61	45.84	56.86	-11.02	QP	100	66	

REMARKS:
(1) Measurement Value = Reading Level + Correct Factor.
(2) Margin Level = Measurement Value - Limit Value.

3.2.8 TEST RESULT - ICES

Test Mode	Mode 1	Tested Date	2026/7/9
Test Voltage	AC 120V/60Hz	Polarization	Vertical

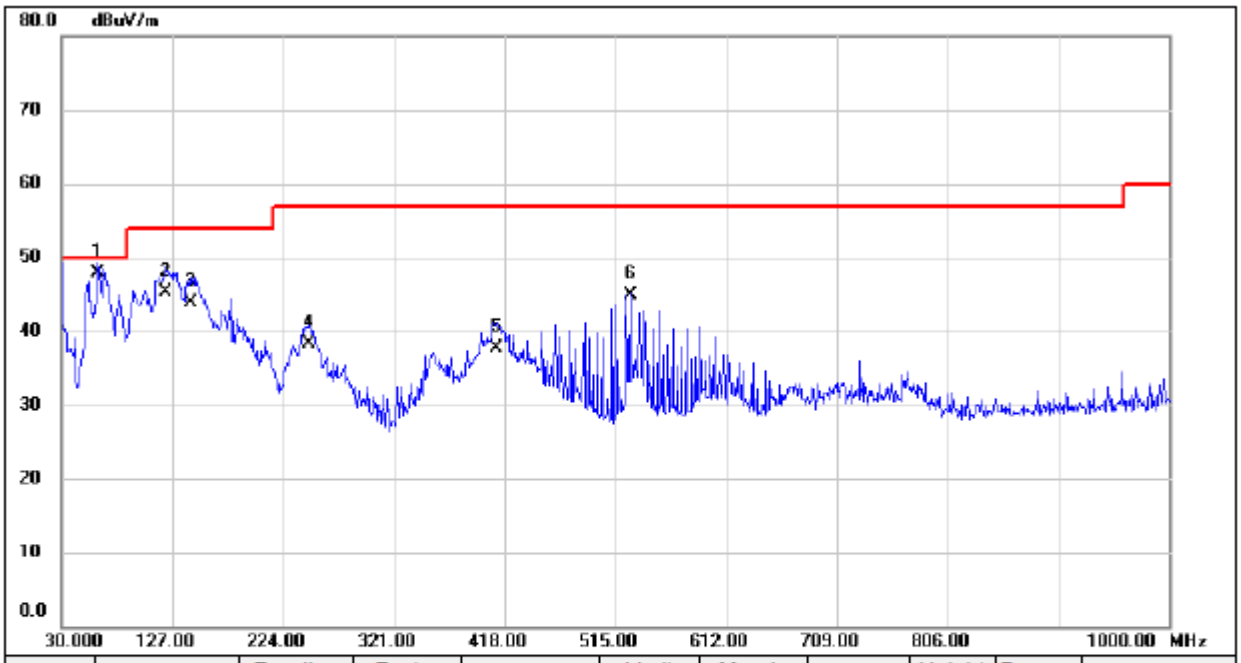

No.		Freq. (MHz)	Reading (dBuV)	Factor (dB/m)	Meas. Level (dBuV/m)	Limit (dBuV/m)	Margin (dB)	Detector	Height (cm)	Degree (deg.)	Comment
1	*	62.0100	61.01	-13.02	47.99	50.00	-2.01	QP	100	114	
2		121.1800	59.95	-14.59	45.36	54.00	-8.64	QP	100	210	
3		142.5200	56.56	-12.58	43.98	54.00	-10.02	QP	100	94	
4		246.3100	51.57	-13.28	38.29	57.00	-18.71	QP	100	78	
5		410.2400	45.98	-8.28	37.70	57.00	-19.30	QP	100	178	
6		528.5800	50.96	-6.07	44.89	57.00	-12.11	QP	100	158	

REMARKS:
(1) Measurement Value = Reading Level + Correct Factor.
(2) Margin Level = Measurement Value - Limit Value.

Test Mode	Mode 1	Tested Date	2026/7/9
Test Voltage	AC 120V/60Hz	Polarization	Horizontal

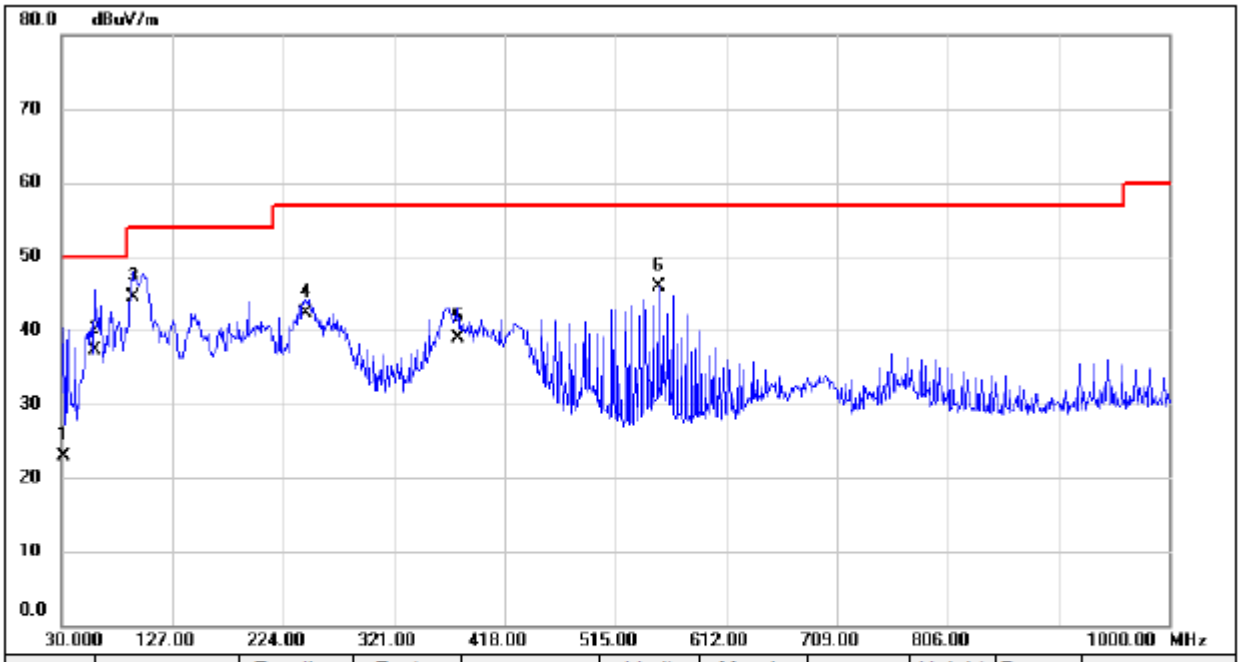

No.		Freq. (MHz)	Reading (dBuV)	Factor (dB/m)	Meas. Level (dBuV/m)	Limit (dBuV/m)	Margin (dB)	Detector	Height (cm)	Degree (deg.)	Comment
1		31.9400	36.36	-13.45	22.91	50.00	-27.09	QP	100	287	
2		59.1000	49.87	-12.56	37.31	50.00	-12.69	QP	100	291	
3	*	92.0800	62.55	-18.05	44.50	54.00	-9.50	QP	200	77	
4		244.3700	55.67	-13.43	42.24	57.00	-14.76	QP	100	307	
5		377.2600	48.17	-9.22	38.95	57.00	-18.05	QP	100	227	
6		552.8300	51.45	-5.61	45.84	57.00	-11.16	QP	100	66	

REMARKS:
(1) Measurement Value = Reading Level + Correct Factor.
(2) Margin Level = Measurement Value - Limit Value.

4 TEST PHOTOS

AC power line conducted emissions test photos

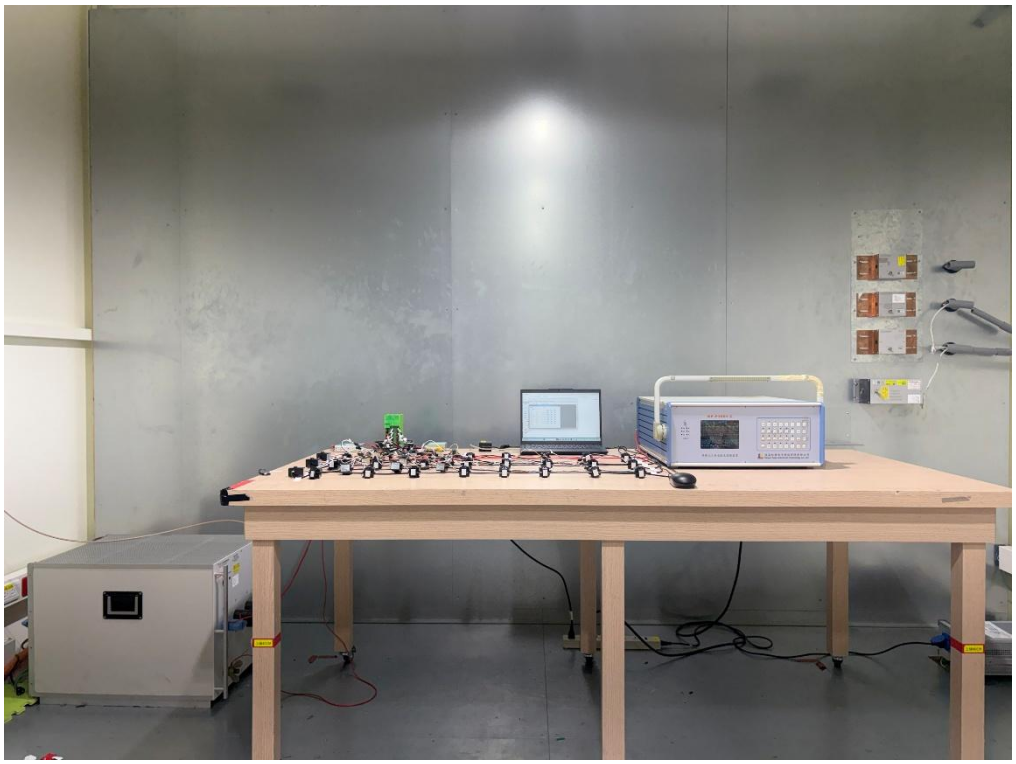

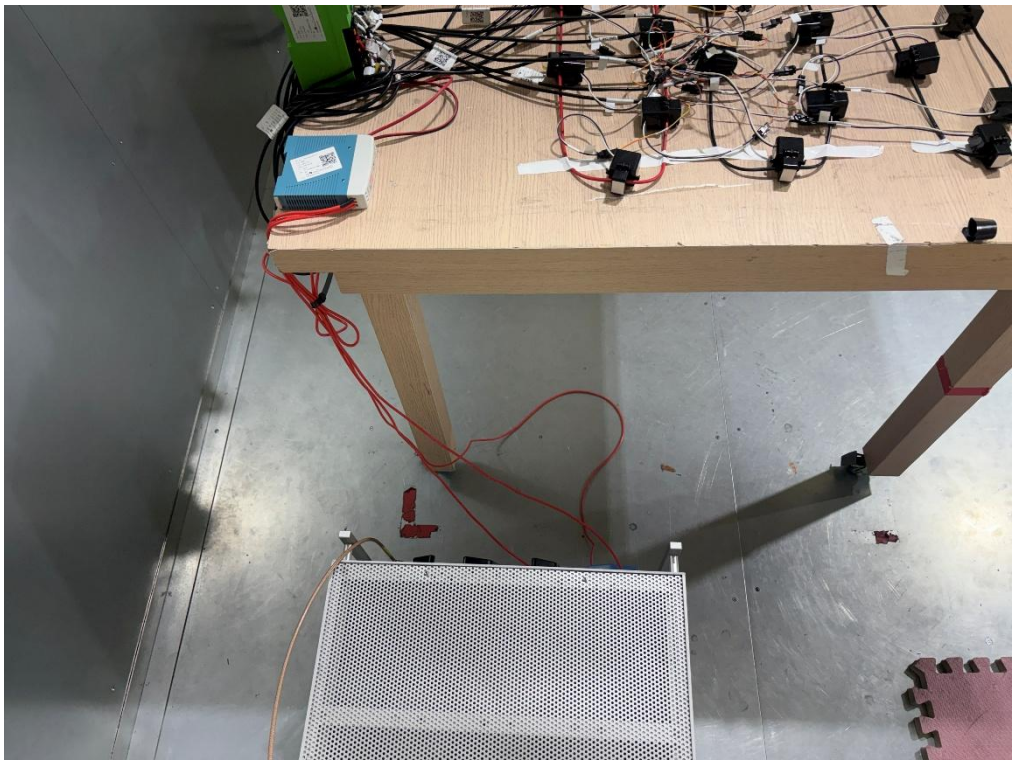

Radiated emissions below 1 GHz test photos

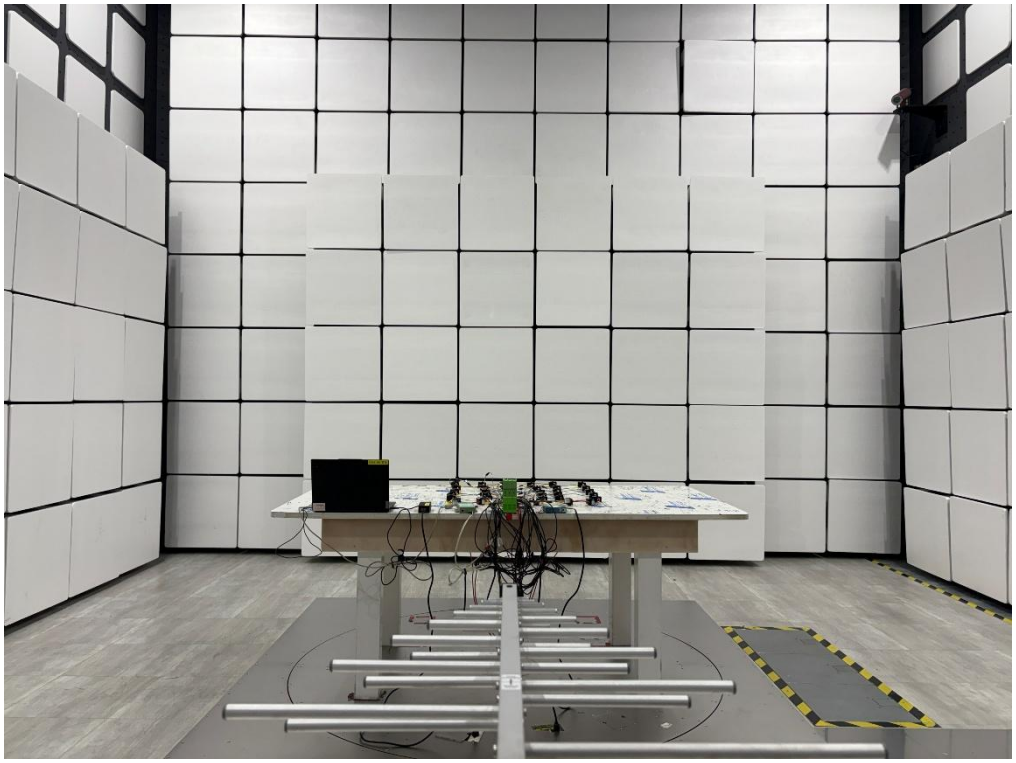

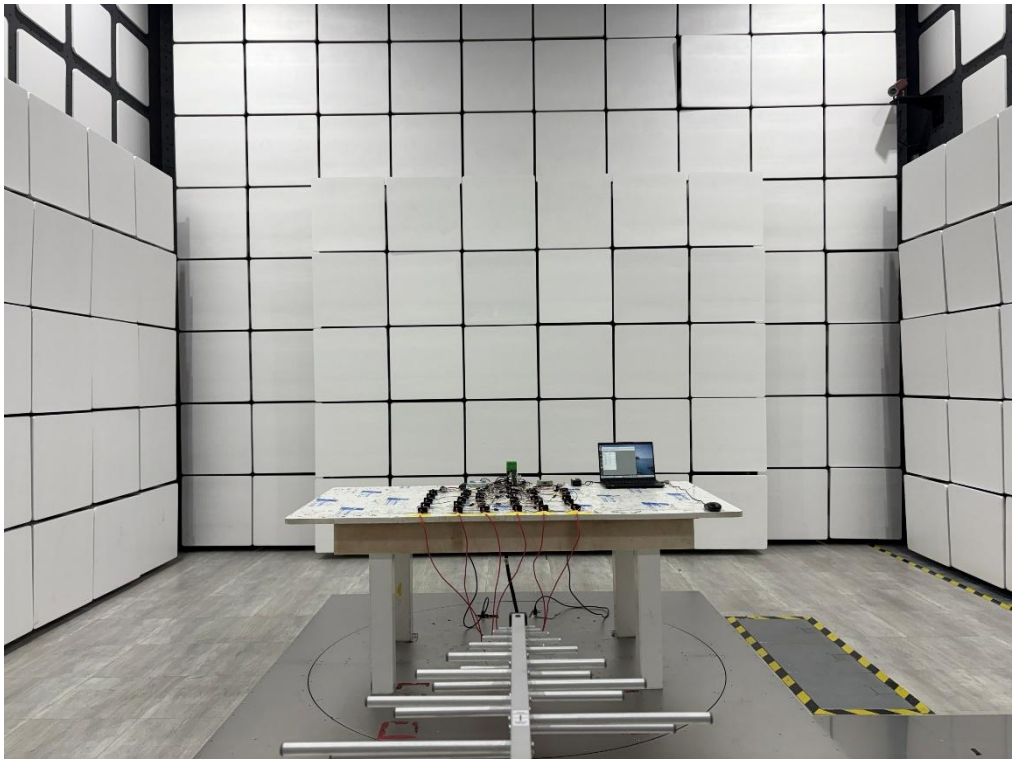

5 EUT PHOTOS

Please refer to document Appendix No.: EP-2605T132-1 (APPENDIX-EUT PHOTOS).

End of Test Report